

July 30, 2003

INITIAL 52.2 TEST REPORT


LMS Technologies, Inc.

P. O. Box 24185
Edina, Minnesota 55424 U.S.A.

Tel.: (952)-918-9060
Fax: (952) 918-9061

| | | | |
|----------------------------|-----------------------|----------------------------|-------------------------|
| Test Type : | Fractional Efficiency | Test Requested By: | Air Quality Engineering |
| Test Number: | T073003A | Filter Mfgr: | |
| Flow Rate/Velocity: | Unit flow | Media Mfgr.: | |
| Test Aerosol: | KCL, Neutralized | Filter/Media ID # : | Model XJ-2 |
| DP ("H2O): | System not accessible | Filter/Media Size: | |

| Size Rang(mm) | Initial Fractional Efficiency(%) |
|----------------|----------------------------------|
| 0.3-0.4 | 99.999 |
| 0.4-0.55 | 100.000 |
| 0.55-0.7 | 100.000 |
| 0.7-1.0 | 100.000 |
| 1.0-1.3 | 100.000 |
| 1.3-1.6 | 100.000 |
| 1.6-2.2 | 100.000 |
| 2.2-3.0 | 100.000 |
| 3.0-4.0 | 100.000 |
| 4.0-5.5 | 100.000 |
| 5.5-7.0 | 100.000 |
| 7.0-10.0 | 100.000 |

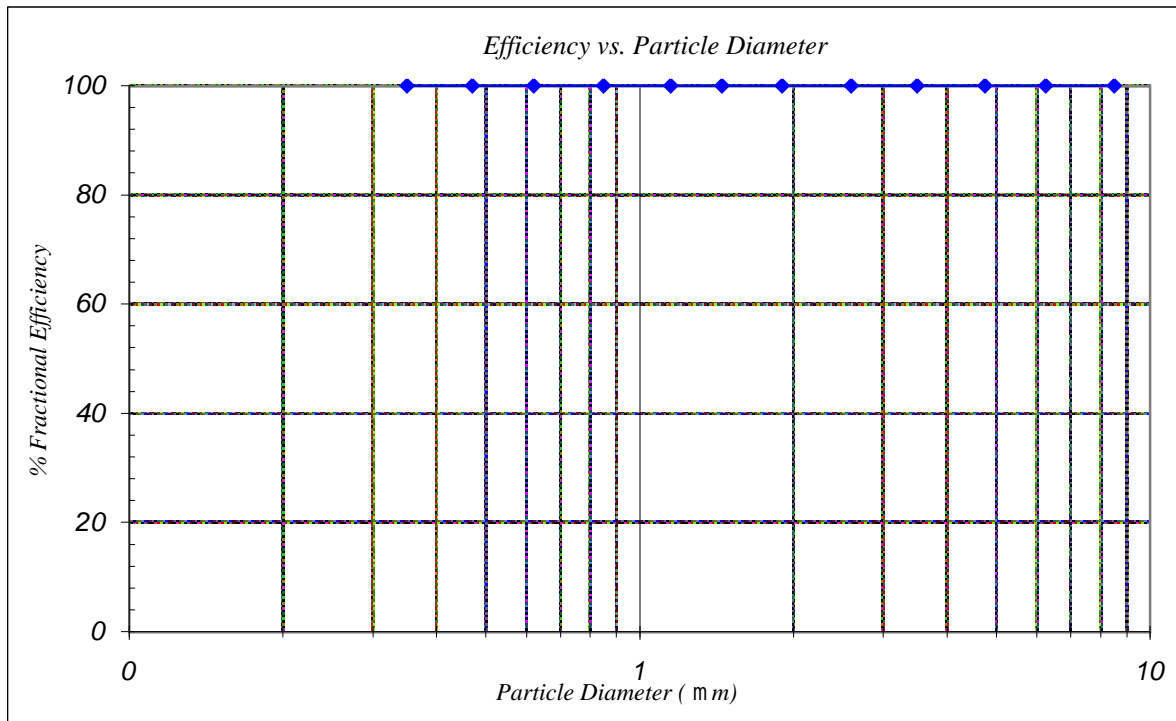

TEST SUPERVISOR
MICK FLOM _____

ENGINEERING APPROVAL
K.C. KWOK, PH.D. _____